


AIR AND WATER RESULTS - 2" x 2" BACK SECTION - PART # 2402

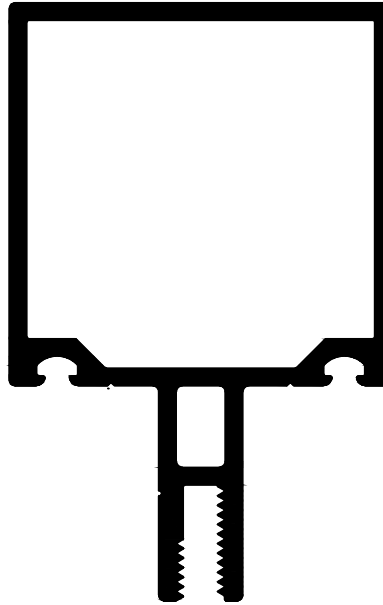


TESTED IN ACCORDANCE WITH - CSA-A440 – NFRC THERMAL SOFTWARE					
THERMAL DATA					
U-VALUE	W/M2-K	BTU/H-FT2F0	SHGC	CI	VT
	N/A	N/A	N/A	N/A	N/A

TESTING IN ACCORDANCE – ASTM E283				
AIR LEAKAGE	TEST PRESSURE	INFILTRATION	EXFILTRATION	OVERALL RESULT
	75PA	0.278 L/S/M2 0.055 CFM/FT2	0.274 L/S/M2 0.054 CFM/FT2	LEVEL A3

TESTING IN ACCORDANCE – ASTM E331			
WATER PENETRATION	TEST PRESSURE	DESIGN PRESSURE	OVERALL RESULT
	510PA (10.50PSF)	3360PA (70.2PSF)	PASS

The above results relate only to the product configuration tested. Every effort has been taken to accurately report the performance of the material, however, due to large amount of input data and reliance from outside sources, it is possible that some errors and/or omissions may occur.

AIR AND WATER RESULTS - 2" x 2 3/4" BACK SECTION - PART # 2427

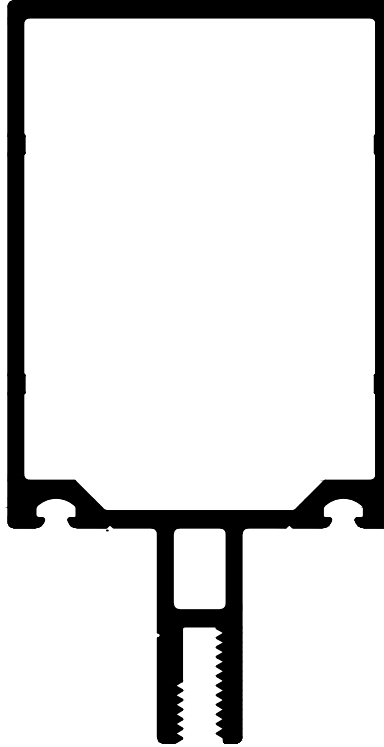


TESTED IN ACCORDANCE WITH - CSA-A440 – NFRC THERMAL SOFTWARE					
THERMAL DATA					
U-VALUE	W/M2-K	BTU/H-FT2F0	SHGC	CI	VT
	N/A	N/A	N/A	N/A	N/A

TESTING IN ACCORDANCE – ASTM E283				
AIR LEAKAGE	TEST PRESSURE	INFILTRATION	EXFILTRATION	OVERALL RESULT
	75PA	0.278 L/S/M2 0.055 CFM/FT2	0.274 L/S/M2 0.054 CFM/FT2	LEVEL A3

TESTING IN ACCORDANCE – ASTM E331			
WATER PENETRATION	TEST PRESSURE	DESIGN PRESSURE	OVERALL RESULT
	510PA (10.50PSF)	3360PA (70.2PSF)	PASS

The above results relate only to the product configuration tested. Every effort has been taken to accurately report the performance of the material, however, due to large amount of input data and reliance from outside sources, it is possible that some errors and/or omissions may occur.

THERMAL, AIR, AND WATER RESULTS - 2" x 4" BACK SECTION - PART # 2404

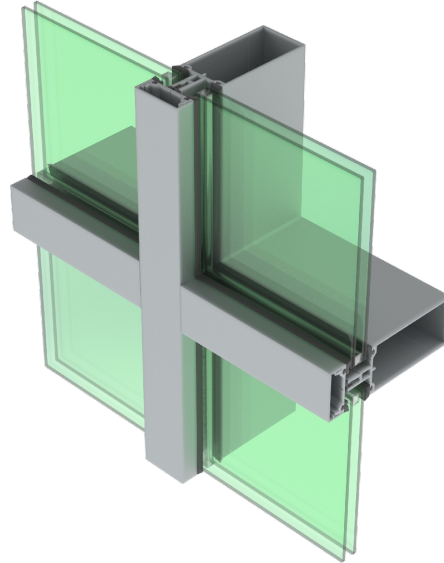

ALUMINUM PRESSURE PLATE

TESTED IN ACCORDANCE WITH - CSA-A440 – NFRC THERMAL SOFTWARE					
THERMAL DATA – 6mm CARDINAL 366 LOW E #2//6mm CLEAR					
U-VALUE	W/M2-K	BTU/H-FT2F0	SHGC	CI	VT
	2.321	0.409	0.259	N/A	N/A

FIBRE GLASS PRESSURE PLATE


TESTED IN ACCORDANCE WITH - CSA-A440 – NFRC THERMAL SOFTWARE					
THERMAL DATA – 6mm SUNGUARD SN68 LOW E #2//6mm CLEAR					
U-VALUE	W/M2-K	BTU/H-FT2F0	SHGC	CR	VT
	1.906	0.336	0.307	62.9	0.518

TESTING IN ACCORDANCE – ASTM E283				
AIR LEAKAGE	TEST PRESSURE	INFILTRATION	EXFILTRATION	OVERALL RESULT
	75PA	0.278 L/S/M2 0.055 CFM/FT2	0.274 L/S/M2 0.054 CFM/FT2	LEVEL A3

TESTING IN ACCORDANCE – ASTM E331			
WATER PENETRATION	TEST PRESSURE	DESIGN PRESSURE	OVERALL RESULT
	510PA (10.50PSF)	3360PA (70.2PSF)	PASS

The above results relate only to the product configuration tested. Every effort has been taken to accurately report the performance of the material, however, due to large amount of input data and reliance from outside sources, it is possible that some errors and/or omissions may occur.

AIR AND WATER RESULTS - 2" x 4" SPLIT BACK SECTION - PART # 2414/2441

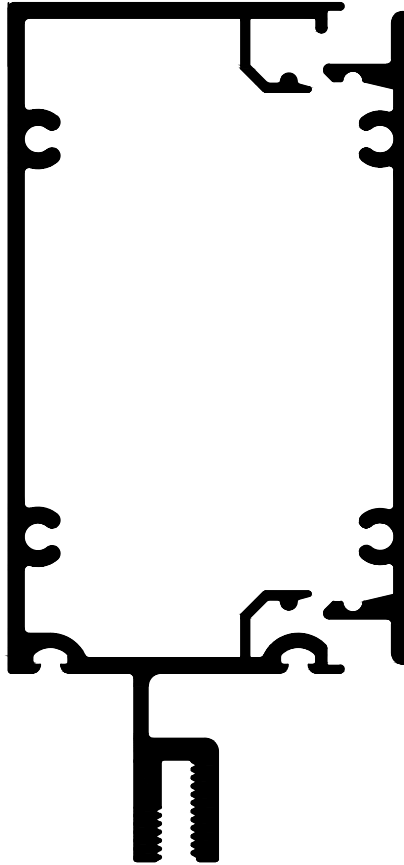


TESTED IN ACCORDANCE WITH - CSA-A440 – NFRC THERMAL SOFTWARE					
THERMAL DATA					
U-VALUE	W/M2-K	BTU/H-FT2F0	SHGC	CI	VT
	N/A	N/A	N/A	N/A	N/A

TESTING IN ACCORDANCE – ASTM E283				
AIR LEAKAGE	TEST PRESSURE	INFILTRATION	EXFILTRATION	OVERALL RESULT
	75PA	0.278 L/S/M2 0.055 CFM/FT2	0.274 L/S/M2 0.054 CFM/FT2	LEVEL A3

TESTING IN ACCORDANCE – ASTM E331			
WATER PENETRATION	TEST PRESSURE	DESIGN PRESSURE	OVERALL RESULT
	510PA (10.50PSF)	3360PA (70.2PSF)	PASS

The above results relate only to the product configuration tested. Every effort has been taken to accurately report the performance of the material, however, due to large amount of input data and reliance from outside sources, it is possible that some errors and/or omissions may occur.

AIR AND WATER RESULTS - 2" x 5 1/4" BACK SECTION - PART # 2425S

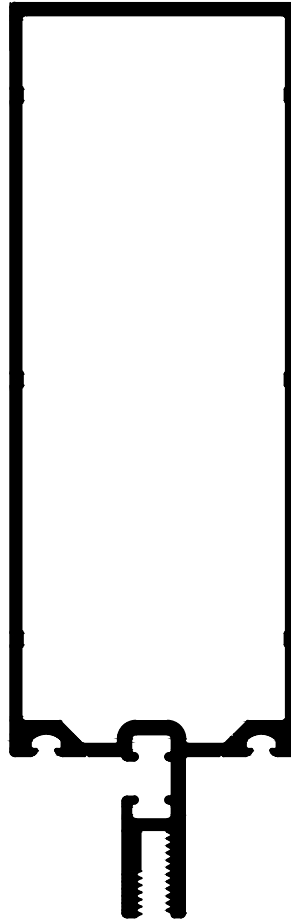


TESTED IN ACCORDANCE WITH - CSA-A440 – NFRC THERMAL SOFTWARE					
THERMAL DATA					
U-VALUE	W/M2-K	BTU/H-FT2F0	SHGC	CI	VT
	N/A	N/A	N/A	N/A	N/A

TESTING IN ACCORDANCE – ASTM E283				
AIR LEAKAGE	TEST PRESSURE	INFILTRATION	EXFILTRATION	OVERALL RESULT
	75PA	0.278 L/S/M2 0.055 CFM/FT2	0.274 L/S/M2 0.054 CFM/FT2	LEVEL A3

TESTING IN ACCORDANCE – ASTM E331			
WATER PENETRATION	TEST PRESSURE	DESIGN PRESSURE	OVERALL RESULT
	510PA (10.50PSF)	3360PA (70.2PSF)	PASS

The above results relate only to the product configuration tested. Every effort has been taken to accurately report the performance of the material, however, due to large amount of input data and reliance from outside sources, it is possible that some errors and/or omissions may occur.

AIR AND WATER RESULTS - 2" x 6" BACK SECTION - PART # 2426S

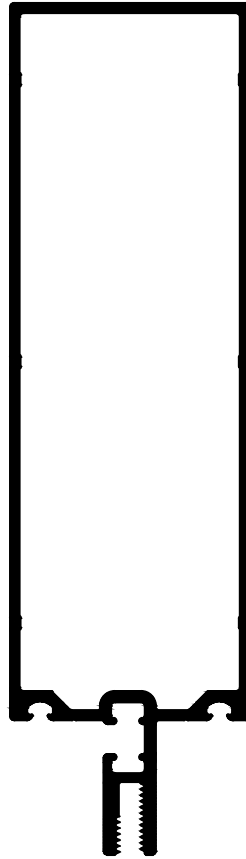

TESTED IN ACCORDANCE WITH - CSA-A440 – NFRC THERMAL SOFTWARE					
THERMAL DATA					
U-VALUE	W/M2-K	BTU/H-FT2F0	SHGC	CI	VT
	N/A	N/A	N/A	N/A	N/A

TESTING IN ACCORDANCE – ASTM E283				
AIR LEAKAGE	TEST PRESSURE	INFILTRATION	EXFILTRATION	OVERALL RESULT
	75PA	0.278 L/S/M2 0.055 CFM/FT2	0.274 L/S/M2 0.054 CFM/FT2	LEVEL A3

TESTING IN ACCORDANCE – ASTM E331			
WATER PENETRATION	TEST PRESSURE	DESIGN PRESSURE	OVERALL RESULT
	510PA (10.50PSF)	3360PA (70.2PSF)	PASS

The above results relate only to the product configuration tested. Every effort has been taken to accurately report the performance of the material, however, due to large amount of input data and reliance from outside sources, it is possible that some errors and/or omissions may occur.